

### INSTALLATION

Each end of the cable has the same type of male 25-pin D-type connector. Care must be taken when plugging the cable into the CPU-CCM2 module or the OIU to match

the CPU marked connector with the CPU-CCM2 module and the connector marked OIU should only be plugged into the OIU.

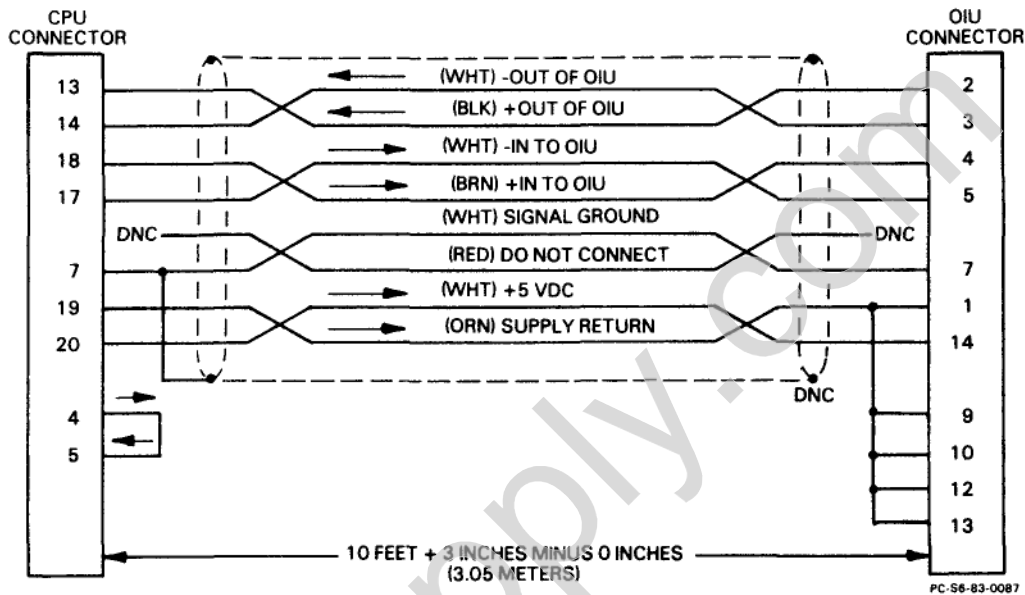


FIGURE 3. WIRING DIAGRAM OF CABLE

### ORDERING INFORMATION

Part Number	Description
IC600WK010A	10 foot (3.05 meters) cable with connectors each end

### CATALOG NUMBER REVISION SUFFIX

The equipment listed above having the catalog numbers shown and the same equipment having a higher alpha suffix is designed for listing by UL for use as auxiliary control devices. The equipment is a direct replacement for equipment having the same catalog number but a lower alpha suffix.



This symbol on the nameplate means the product is listed by Underwriters Laboratories Inc. (UL Standard No. 508, Industrial Control Equipment, subsection Electronic Power Conversion Equipment.)

For further information, contact your local GE Fanuc sales office.

**GE Fanuc Automation North America, Inc., Charlottesville, Virginia**