

IC600YB806
New In Stock!
GE Fanuc

<http://www.pdfsupply.com/automation/ge-fanuc/ge-series-six-6/IC600YB806>

Ge Series Six 6
1-919-535-3180

In Stock! 12Vac/dc Input Module (8 points) IC600Y IC600YB

www.pdfsupply.com

Email: sales@pdfsupply.com

<ul style="list-style-type: none"> • Dimensions: Circuit Board: 8.15 x 11.0 (inches) 208 x 280 (mm) Faceplate: 12.46 x 1.175 (inches) 317 x 30 (mm) • Power Requirements: 5V DC, 104 ma maximum Supplied by I/O power supply. The user must supply power for the input devices. • Number of Inputs: Eight (8), in two groups of 4 inputs with a common, neutral connection. • Operating Temperature: 0⁰ to 60⁰C (At the outside of rack) • Storage Temperature: -20⁰ to +80⁰C 	<ul style="list-style-type: none"> • Humidity: 5 to 95% (non-condensing) <table border="1"> <thead> <tr> <th>Module</th> <th>ON Range</th> <th>OFF Range</th> <th>Input Loading</th> </tr> </thead> <tbody> <tr> <td>12V Input (AC/DC)</td> <td>10-20V</td> <td>0-4V</td> <td>1 k Ω (7.0 ma @ 12V)</td> </tr> <tr> <td>24-48V Input (AC/DC)</td> <td>20-60V</td> <td>0-8V</td> <td>3 k Ω (6.3 ma @ 24V)</td> </tr> <tr> <td>115V Input (AC/DC)</td> <td>90-130V</td> <td>0-30V</td> <td>20 k Ω (5.5 ma @ 115V)</td> </tr> <tr> <td>230V Input (AC/DC)</td> <td>180-260V</td> <td>0-50V</td> <td>39 k Ω (5.8 ma @ 230V)</td> </tr> </tbody> </table> <p>ON Delay: 10-20 ms OFF Delay: 20-50 ms</p>	Module	ON Range	OFF Range	Input Loading	12V Input (AC/DC)	10-20V	0-4V	1 k Ω (7.0 ma @ 12V)	24-48V Input (AC/DC)	20-60V	0-8V	3 k Ω (6.3 ma @ 24V)	115V Input (AC/DC)	90-130V	0-30V	20 k Ω (5.5 ma @ 115V)	230V Input (AC/DC)	180-260V	0-50V	39 k Ω (5.8 ma @ 230V)
Module	ON Range	OFF Range	Input Loading																		
12V Input (AC/DC)	10-20V	0-4V	1 k Ω (7.0 ma @ 12V)																		
24-48V Input (AC/DC)	20-60V	0-8V	3 k Ω (6.3 ma @ 24V)																		
115V Input (AC/DC)	90-130V	0-30V	20 k Ω (5.5 ma @ 115V)																		
230V Input (AC/DC)	180-260V	0-50V	39 k Ω (5.8 ma @ 230V)																		

FIGURE 1. SPECIFICATIONS

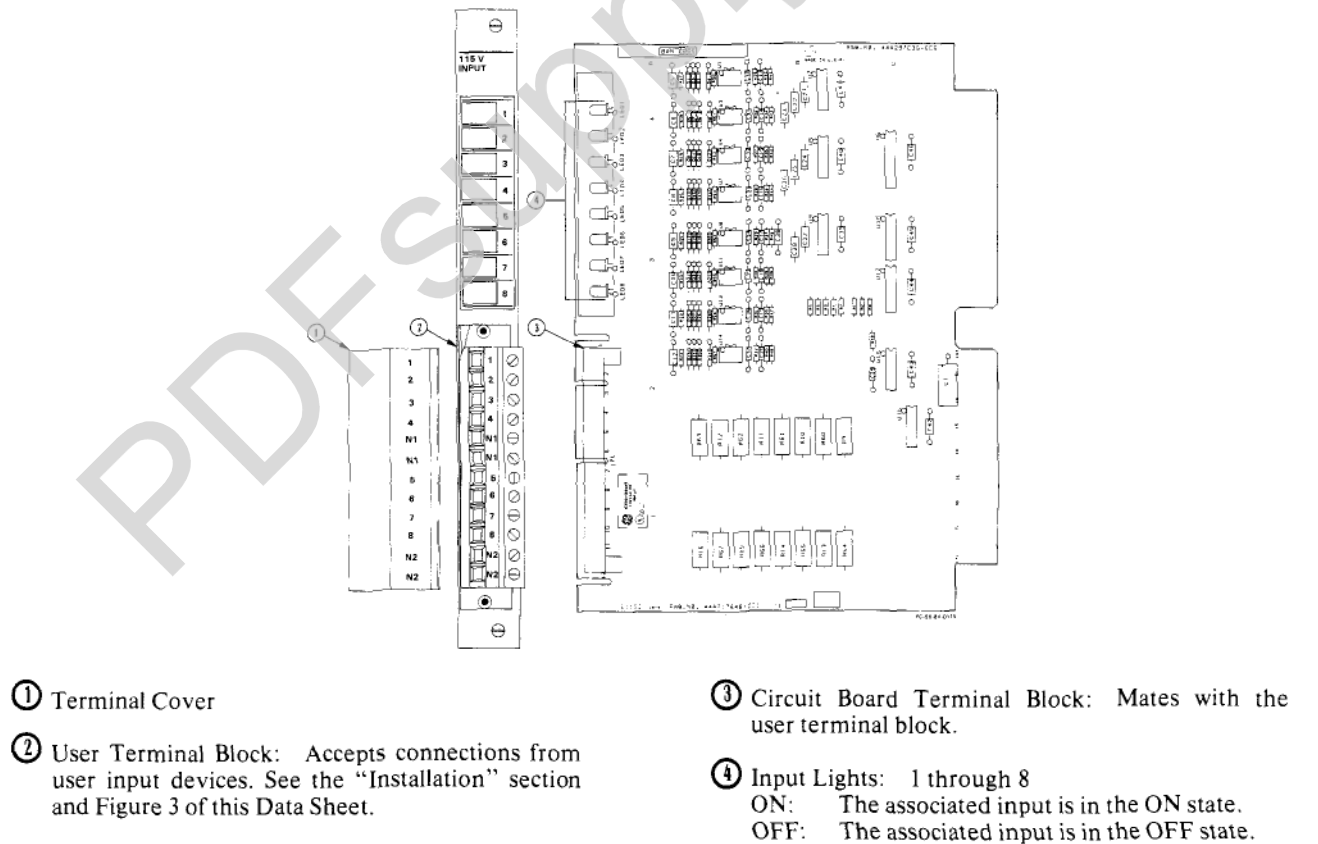


FIGURE 2. USER ITEMS

INSTALLATION

The AC/DC Input modules can be installed in an I/O rack or the I/O rack section of the Model 60 Central Processor Unit (CPU). Follow these steps:

1. Set the Dual-In-Line-Package (DIP) switches directly behind the card slot on the rack backplane to establish the correct correspondence between the input terminals on this module and a group of eight consecutive input numbers in the user program. For further information on I/O DIP-switch settings, refer to the Installation Section of the Series Six Installation and Maintenance Manual (GEK-25361).
 2. Use the extraction/insertion tool furnished with the Series Six CPU to insert (or remove) this module in the card slot.
 3. Guide the faceplate over the circuit board so that the terminals near the bottom of each are mated; secure the faceplate to the rack using the thumb-screws at the top and bottom.
 4. Refer to Figure 3. Connect one side of the user circuit to the appropriate input terminal (1 through 8). Circuits connected to inputs 1 through 4 must have their opposite sides connected to either of the N1 terminals. Likewise, circuits connected to inputs 5 through 8 must have their opposite sides connected to either of the N2 terminals.
- In reference to Figure 3, note that wires connected to the N1 terminals are at the same potential, as are wires connected to the N2 terminals.
- Each input terminal can accommodate one No. 12 AWG wire or two No. 14 AWG wires.
5. Guide the terminal cover onto the top of the terminal block, then slide it downward over the terminals.

A markable area is provided on the plastic lens beside each LED for noting the function or source of each input. The faceplates are color coded:

- Green: 12V or 24-48V
- Orange: 115v
- White: 230V

WARNING

Voltages from user field devices may be present on the faceplate terminals, even if the power supply in the I/O rack is off. Care should be taken when handling the faceplate of this module or any wires connected to it.

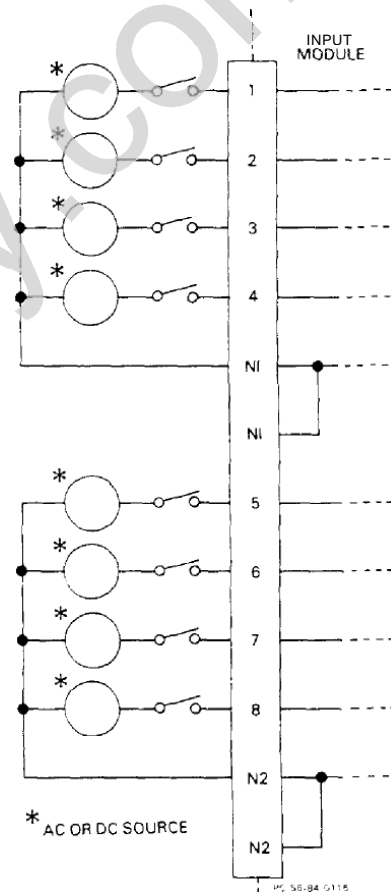


FIGURE 3. TYPICAL USER INPUT CONNECTIONS

ORDERING INFORMATION

<u>Module</u>	<u>Circuit Board and Faceplate</u>	<u>Circuit Board</u>	<u>Faceplate</u>
12 Vac/dc	IC600BF806B	IC600YB806B	IC600FP806A
24-48 Vac/dc	IC600BF802B	IC600YB802B	IC600FP802A
115 Vac/dc	IC600BF804B	IC600YB804B	IC600FP804A
230 Vac/dc	IC600BF805B	IC600YB805B	IC600FP805A

CATALOG NUMBER REVISION SUFFIX

The equipment listed above having the catalog numbers shown and the same equipment having a higher alpha suffix is designed for listing by UL for use as auxiliary control devices. The equipment is a direct replacement for equipment having the same catalog number but a lower alpha suffix.

The UL symbol on the nameplate means the product is listed by Underwriters Laboratories Inc. (UL Standard No. 508, Industrial Control Equipment, subsection Electronic Power Conversion Equipment.)

For further information, contact your local GE Fanuc sales office.

GE FANUC AUTOMATION NORTH AMERICA, INC., CHARLOTTESVILLE, VIRGINIA